Exhibit B-5

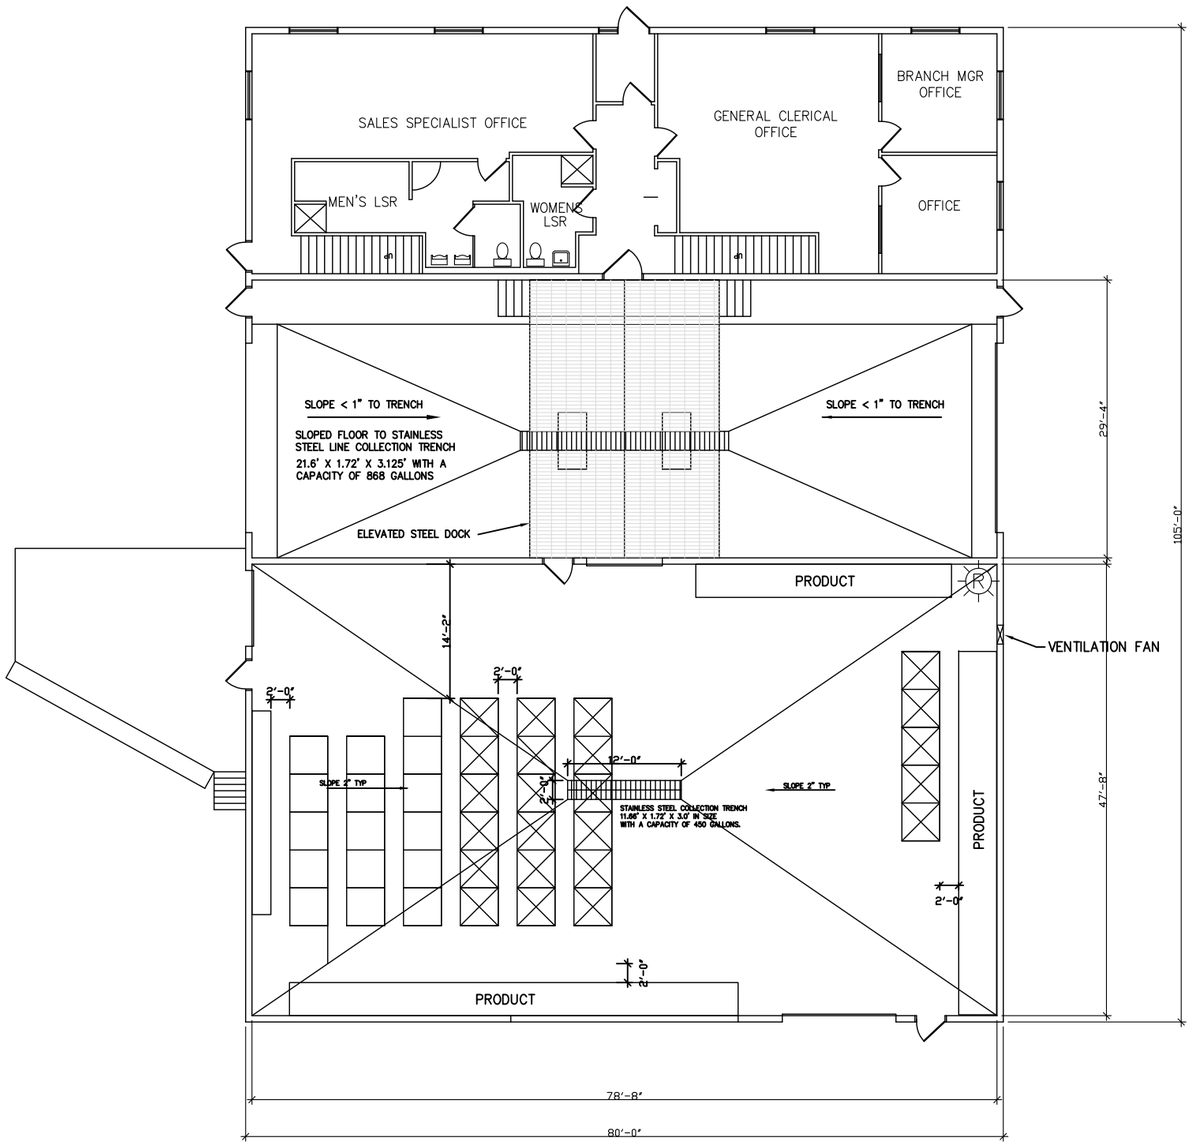

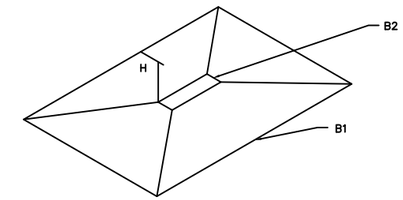

CONTAINMENT FORMULA USED:
$(1/3)(H)(B1+B2+\sqrt{B1 \times B2})$

B1 = (78'–8"'x48'–8") 3828.4 S.F
B2 = (12'–0" X 2'–0") 24 S.F.
H = 2"

√ OF B1 X B2 (91872) =303
3828 + 24 + 303 = 4155 S.F.
4155 S.F. X 2" (H) = 692.5 C.F.
1/3 x 692.5 = 230.8 C.F.
230.8 C.F. x 7.48 = 1726.3 GALLONS

VOLUME OF TRENCH (L X W X D X 7.48 GAL/CF)
11.66' X 1.72' X 3.0' X 7.48 GAL/CF = 450 GAL

2176.3 TOTAL GALLONS

☐ 10 DAY TRANSFER WASTE STORAGE

☒ PERMITTED WASTE STORAGE

STORAGE ARRANGEMENT

4 CONTAINERS/PALLET X 55 GAL/CONTAINER X 2 PALLETS/STACK X 39 STACKS = 17,160 GALLONS

CONTAINMENT SPECIFICATIONS

FLOOR AREA CONTAINMENT AVAILIBLE = 1,726 GALLONS
TRENCH CAPACITY = 450 GALLONS
TOTAL CONTAINMENT AVAILIBLE = 2,176 GALLONS
CONTAINMENT REQUIRED = 10% OF 17,160 = 1,716 GALLONS
EXCESS CONTAINMENT = 460 GALLONS

PROPRIETARY STATEMENT

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF SAFETY–KLEEN CORP. AND IS PROPRIETARY AND CONFIDENTIAL INFORMATION. THIS DRAWING AND THE INFORMATION CONTAINED THEREIN MUST NOT BE DUPLICATED, USED, DIVULGED, REPRODUCED, COPIED, DISCLOSED OR APPROPRIATED IN WHOLE OR IN PART FOR ANY PURPOSE OTHER THAN AS EXPRESSLY AUTHORIZED BY SAFETY–KLEEN CORP. THIS DRAWING MUST BE RETURNED PROMPTLY UPON REQUEST.

NO.	DESCRIPTION	BY	CHK	APPR	DATE
1	REVISE TO SHOW CURRENT STORAGE CONDITIONS	JEK	–	–	041406
1	UPDATE FOR PART B	JEK	–	–	042804

REVISIONS

TITLE
WAREHOUSE PALLET LAYOUT

SAFETY–KLEEN SYSTEMS, INC.
2600 N. CENT. EXPRESSWAY STE 400 RICHARDSON, TX, 75080
PHONE 800–669–5740

SCALE	BY	CHKD	P.E. APPR	OP. APPR	DATE
1/8"=1'	WEY	WEY	–	–	12–10–93

SERVICE CENTER BRANCH AT: CHANDLER, AZ

STD–DWG–REV NO.: 7134–WB00–003–2