

David A. Burchard
Arizona Department of Environmental Quality, PHX
1110 W. Washington Street
Phoenix, AZ 85007

Project: School Lead Testing Screening
Project Number: Lindbergh Elementary School

Reported:
05/05/17 16:28

Analyte

1001-1 (7042686-01) Drinking Water (Grab) Sampled: 04/18/17 06:02 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 15:57	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

1001-2 (7042686-02) Drinking Water (Grab) Sampled: 04/18/17 06:09 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:01	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

1002-1 (7042686-03) Drinking Water (Grab) Sampled: 04/19/17 06:07 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	5.2	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:20	EPA 200.8
------	-----	-----	------	---	---------	----------------	----------------	-----------

1002-2 (7042686-04) Drinking Water (Grab) Sampled: 04/18/17 06:20 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	8.4	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:24	EPA 200.8
------	-----	-----	------	---	---------	----------------	----------------	-----------

1003-1 (7042686-05) Drinking Water (Grab) Sampled: 04/18/17 06:14 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:28	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

1003-2 (7042686-06) Drinking Water (Grab) Sampled: 04/18/17 06:16 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:32	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

1004-1 (7042686-07) Drinking Water (Grab) Sampled: 04/18/17 06:10 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
---------	--------	-----	-------	----------	-------	----------	----------	--------	-------

Legend Technical Services of Arizona, Inc.



Client Services Representative

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Phone Number: (602) 324-6100

Page 1 of 22

David A. Burchard
Arizona Department of Environmental Quality, PHX
1110 W. Washington Street
Phoenix, AZ85007

Project: School Lead Testing Screening
Project Number: Lindbergh Elementary School

Reported:
05/05/17 16:28

1004-1 (7042686-07) Drinking Water (Grab) Sampled: 04/18/17 06:10 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	5.0	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:36	EPA 200.8
------	-----	-----	------	---	---------	----------------	----------------	-----------

1004-2 (7042686-08) Drinking Water (Grab) Sampled: 04/18/17 06:12 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:39	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

1005-1 (7042686-09) Drinking Water (Grab) Sampled: 04/18/17 06:06 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	5.7	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:43	EPA 200.8
------	-----	-----	------	---	---------	----------------	----------------	-----------

1005-2 (7042686-10) Drinking Water (Grab) Sampled: 04/18/17 06:08 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	7.1	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:47	EPA 200.8
------	-----	-----	------	---	---------	----------------	----------------	-----------

1006-1 (7042686-11) Drinking Water (Grab) Sampled: 04/18/17 06:01 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	10	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:51	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

1006-2 (7042686-12) Drinking Water (Grab) Sampled: 04/19/17 06:12 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	9.6	5.0	ug/L	1	B7E0981	05/02/17 10:40	05/03/17 16:55	EPA 200.8
------	-----	-----	------	---	---------	----------------	----------------	-----------

1008-1 (7042686-13) Drinking Water (Grab) Sampled: 04/19/17 05:59 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	6.2	5.0	ug/L	1	B7E0982	05/02/17 10:42	05/03/17 17:25	EPA 200.8
------	-----	-----	------	---	---------	----------------	----------------	-----------

1008-2 (7042686-14) Drinking Water (Grab) Sampled: 04/19/17 06:01 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

David A. Burchard
Arizona Department of Environmental Quality, PHX
1110 W. Washington Street
Phoenix, AZ85007

Project: School Lead Testing Screening
Project Number: Lindbergh Elementary School

Reported:
05/05/17 16:28

1008-2 (7042686-14) Drinking Water (Grab) Sampled: 04/19/17 06:01 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	20	5.0	ug/L	1	B7E0982	05/02/17 10:42	05/03/17 17:29	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

1010-1 (7042686-15) Drinking Water (Grab) Sampled: 04/19/17 06:03 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	25	5.0	ug/L	1	B7E0982	05/02/17 10:42	05/03/17 17:33	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

1010-2 (7042686-16) Drinking Water (Grab) Sampled: 04/19/17 06:04 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	19	5.0	ug/L	1	B7E0982	05/02/17 10:42	05/03/17 17:36	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

1016-1 (7042686-17) Drinking Water (Grab) Sampled: 04/19/17 06:09 Received: 04/27/17 16:00

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0982	05/02/17 10:42	05/03/17 17:40	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

Sample Condition Upon Receipt:

Temperature: 27.20 °C

All samples were received in acceptable condition unless noted otherwise in the case narrative.

Case Narrative:

Holding Times: All holding times were met unless otherwise qualified.

QA/QC Criteria: All analyses met method requirements unless otherwise qualified.

Accreditations: AZ(PHX)0004, AZ(TUC)0004, AIHA#102982, CDC ELITE Member.

Accreditation is applicable only to the test methods specified on each scope of accreditation held by LEGEND.

Comments: There were no problems encountered during the processing of the samples, unless otherwise noted.
All samples were analyzed on a "wet" basis unless designated as "dry weight".

Lead samples are preserved with Nitric acid upon receipt at the laboratory. However, some samples were analyzed prior to the 16 hour preservation waiting period due to urgency of analysis, per the client's request. Results are not for compliance purpose.

Notes and Definitions

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-01

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	400 building #1001
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	next to the kitchen (mpb) 405
Sample Identification Number (Write this number on the sample container and on this sheet)	1001-1
Date of Collection	4/18/17
Time of Collection	6:02 AM
Printed Name of Sample Collector	JOSE LOYILLEN
Signature Sample Collector	<i>Jose Loyillen</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Received 4/27/17 1200 @ lab 27.2°C

For relinquishing samples upon delivery to labs only

Relinquished date and signature

These samples were collected for lead screening purposes only and cannot be used for compliance.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-02

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	400 building #1001
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	old front office Room 405
Sample Identification Number (Write this number on the sample container and on this sheet)	1001-2
Date of Collection	4/18/17
Time of Collection	6:09 AM
Printed Name of Sample Collector	Jose Goyfien
Signature Sample Collector	<i>Jose Goyfien</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District
School Name
Building (name/number)
Type of Fixture (tap, drinking fountain etc.)
Location of Fixture (example, room number)
Sample Identification Number (**Write this number on the sample container and on this sheet**)

Mesa Unified District
Lindbergh Elementary School
Media center 501 # 1002
Drinking Fountain
Room 501
1002-1
4/19/17
6:07 AM
Jose Leiffler
Jose Leiffler

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-04

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	500 Building #1002
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	media center 501
Sample Identification Number (Write this number on the sample container and on this sheet)	1002-2
Date of Collection	4/18/17
Time of Collection	6:20 am
Printed Name of Sample Collector	Jose Guillen
Signature Sample Collector	<i>Jose Guillen</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-05

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	300 Building #1003
Type of Fixture (tap, drinking fountain etc.)	Drinking faucet outside
Location of Fixture (example, room number)	outside next to Restrooms
Sample Identification Number (Write this number on the sample container and on this sheet)	1003-1
Date of Collection	4/18/17
Time of Collection	6:14 am
Printed Name of Sample Collector	Jose Coville
Signature Sample Collector	<i>Jose Coville</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	300 building #1003
Type of Fixture (tap, drinking fountain etc.)	Drinking fountain inside
Location of Fixture (example, room number)	Room 302
Sample Identification Number (Write this number on the sample container and on this sheet)	1003-2
Date of Collection	4/18/17
Time of Collection	6:16 am
Printed Name of Sample Collector	Jae Guillen
Signature Sample Collector	Jae Guillen

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature

These samples were collected for lead screening purposes only and cannot be used for compliance.


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-07

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	200 building Room 201 #1004
Type of Fixture (tap, drinking fountain etc.)	Drinking Faucet
Location of Fixture (example, room number)	room 201
Sample Identification Number (Write this number on the sample container and on this sheet)	1004-1
Date of Collection	4/18/17
Time of Collection	6:10 Am
Printed Name of Sample Collector	Jose Guillen
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	200 building # 1004
Type of Fixture (tap, drinking fountain etc.)	Drinking faucet outside
Location of Fixture (example, room number)	outside faucet next to Restrooms
Sample Identification Number (Write this number on the sample container and on this sheet)	1004-2
Date of Collection	4/18/17
Time of Collection	6:12 am
Printed Name of Sample Collector	JOSE GRIJLEN
Signature Sample Collector	<i>Jose Grijlen</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	100 building # 1005
Type of Fixture (tap, drinking fountain etc.)	Drinking fountain
Location of Fixture (example, room number)	outside next to restrooms
Sample Identification Number (Write this number on the sample container and on this sheet)	1005-1
Date of Collection	4/18/17
Time of Collection	6:00 am
Printed Name of Sample Collector	Jose Cuatlen
Signature Sample Collector	<i>[Signature]</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-10

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District
School Name
Building (name/number)
Type of Fixture (tap, drinking fountain etc.)
Location of Fixture (example, room number)
Sample Identification Number (**Write this number on the sample container and on this sheet**)
Date of Collection
Time of Collection
Printed Name of Sample Collector
Signature Sample Collector

Mesa Unified District
Lindbergh Elementary School
100 building #1005
Drinking Faucet
Room 109 (109)
1005-2
4/18/17
6:08am
Jose Guillen
<i>[Signature]</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

70424826-11

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District
School Name
Building (name/number)
Type of Fixture (tap, drinking fountain etc.)
Location of Fixture (example, room number)
Sample Identification Number (**Write this number on the sample container and on this sheet**)

Mesa Unified District
Lindbergh Elementary School
Kln 1315 # 1006
Sink
Kln Room 315
1006 - 1
4/18/17
6:01 Am
Jose Guillen
Joe Guillen

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-12

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	Kiln # 1006
Type of Fixture (tap, drinking fountain etc.)	Sink
Location of Fixture (example, room number)	315
Sample Identification Number (Write this number on the sample container and on this sheet)	1006 - 2
Date of Collection	4/19/17
Time of Collection	6:12 AM
Printed Name of Sample Collector	Jose Coville
Signature Sample Collector	<i>Jose Coville</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	314 portable # 1008
Type of Fixture (tap, drinking fountain etc.)	Drinking fountain
Location of Fixture (example, room number)	Room 314
Sample Identification Number (Write this number on the sample container and on this sheet)	1008-1
Date of Collection	4/19/17
Time of Collection	5:39 AM
Printed Name of Sample Collector	Jose Guillen
Signature Sample Collector	<i>Jose Guillen</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-14

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	Headstart 313 #1008
Type of Fixture (tap, drinking fountain etc.)	Drinking fountain
Location of Fixture (example, room number)	313 room
Sample Identification Number (Write this number on the sample container and on this sheet)	1008-2
Date of Collection	4/19/17
Time of Collection	6:01 am
Printed Name of Sample Collector	Jesse Caniffen
Signature Sample Collector	Jesse Caniffen

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature

These samples were collected for lead screening purposes only and cannot be used for compliance.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-15

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	Portable 704 #1010
Type of Fixture (tap, drinking fountain etc.)	Drinking fountain
Location of Fixture (example, room number)	Room 704
Sample Identification Number (Write this number on the sample container and on this sheet)	1010-1
Date of Collection	4/19/17
Time of Collection	6:03 Am
Printed Name of Sample Collector	Jose Guillen
Signature Sample Collector	[Signature]

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-16

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	703 portable # 1010
Type of Fixture (tap, drinking fountain etc.)	Drinking fountain
Location of Fixture (example, room number)	703
Sample Identification Number (Write this number on the sample container and on this sheet)	1010-2
Date of Collection	4/19/17
Time of Collection	6:04 AM
Printed Name of Sample Collector	Jose Guillen
Signature Sample Collector	<i>Jose Guillen</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042686-17

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

- ☐ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	Mesa Unified District
School Name	Lindbergh Elementary School
Building (name/number)	600 Building Room 610 # 1016
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Room 610
Sample Identification Number (Write this number on the sample container and on this sheet)	1016 - 1
Date of Collection	4/19/17
Time of Collection	6:09 AM
Printed Name of Sample Collector	Jorge Gonzalez
Signature Sample Collector	Jorge Gonzalez

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

Anne M. Lindbergh Elementary School

930 S. Lazona Dr., Mesa AZ 85204

(480) 472-6300 Office


(480) 472-6300 Attendance

(480) 472-6310 Fax

Mr. Heminger, Principal



School Hours 7:45AM - 2:15PM (11:15PM on Wednesdays)

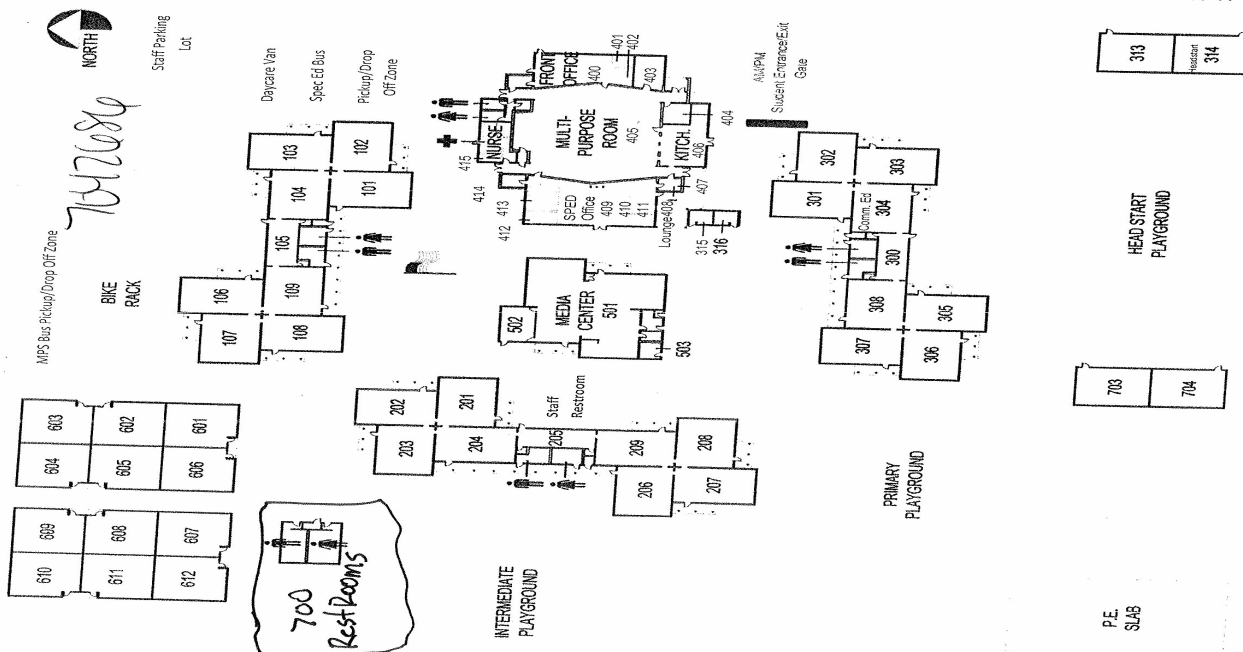

RM	NAME	RM	NAME
101	Shud (ED-Klg)	405	Multi-Purpose Room
102	Cousins (ED-Pim)	404	Collins (P.E.)
103	Pympton (ED-Klg)	406	Kitchen
104	Zanaa (Music)	400	Main Office
106	Hamilton (Music)	402	Heminger (Principal)
107	Estesing (Title I)	401	Galloway (Secretary)
108	Thomas (in PC Lab)	400	Gulden (Off Specialist)
109	Glinar (Intervention)	407	Staff Computer
		408	Teacher's Lounge
201	Rivera (3rd)	409	Monnin (Counselor)
202	Kill (ELD 2nd)	410	Spec Ed Clerk
203	Kinzie (3rd)	411	Marcks, K. (Psych)
204	Hlasman (3rd)	412	Conf Room (Sn)
205	Cop Room	413	Conf Room (Lg)
206	Kikiam (2nd)	414	Cochran (Speech)
207	Bougeois (2nd)	415	Health Office
208	Hard Hat (Monday and	501	Valdez A (Media Center)
209	Occupational Therapy-Fri	502	(Pri PC Lab)
300	K1 Workroom	503	
301	Mann, K (Klg)	601	Salinas (4th)
302	Eno (ELD Klg)	602	Breno (4th)
303	Community Ed	603	Martin, J (Pri SLD)
304	ELD Testing Valdez R	604	Johnson (Art)
305	Kreidlow (1st)	605	Keston (Int SLD)
306	Ebert (1st)	606	Motamedi (4th)
307	Frederick-Klg, ELD Int	607	Bricker (5th)
308	Ryan (Gifted)	608	Frederick-Klg, ELD Int
313	Headstart	609	Catellano (6th)
314	Kin Room	610	Mendez Hirst (6th)
315	Gallent-Lopez (Custodian	611	Bates (5th Combo)
316	Office)	612	
703	Shultz (Orchestra)		
704	Hink (Band)		

7042686

District	School	Building No	Building Desc	Building Use	Year Built	Number of Bottles Per Building
Mesa Unified District	Lindbergh Elementary School	1001	MPR Drinking F.	ADMN/MPR/CLASS ROOM	1973	2
Mesa Unified District	Lindbergh Elementary School	1002	A1000 old office Drink	MEDIA/COMP.	1973	2
Mesa Unified District	Lindbergh Elementary School	1003	300 faucet	CLASSROOM/WOR KROOM 301	1973	2
Mesa Unified District	Lindbergh Elementary School	1004	200 Rest outd. A4000 faucet	CLASSROOM/WOR KROOM 201	1973	2
Mesa Unified District	Lindbergh Elementary School	1005	Room 109 faucet	CLASSROOM/WOR KROOM 109	1973	2
Mesa Unified District	Lindbergh Elementary School	1006	A5000	KILN	1976	2
Mesa Unified District	Lindbergh Elementary School	1008	A8000 / R-145	CLASSROOM	1985	2
Mesa Unified District	Lindbergh Elementary School	1010	A10000 / R-350	CLASSROOM	1985	2
Mesa Unified District	Lindbergh Elementary School	1016	A16000 Room 606	Classrooms	2002	1
Mesa Unified District	Lindbergh Elementary School	1017	A17000 700 Rest R.	Restrooms	2002	1
Address: 930 S Lazona, Mesa, AZ 85204					Number of Bottles Per Kit:	18

no Drinking fountain on 700 Building

media Has only 1 Drinking Faucet need 2

Kiln only has Faucet to wash Hands.