





**UPPER LEVEL**

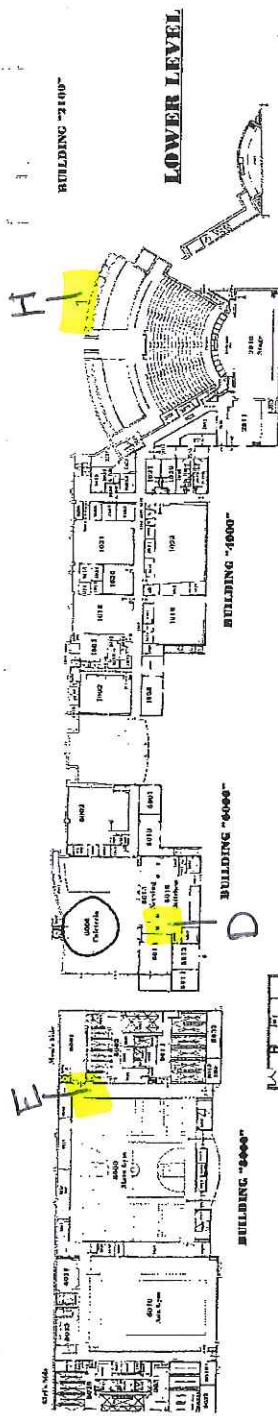

**MAIN LEVEL**

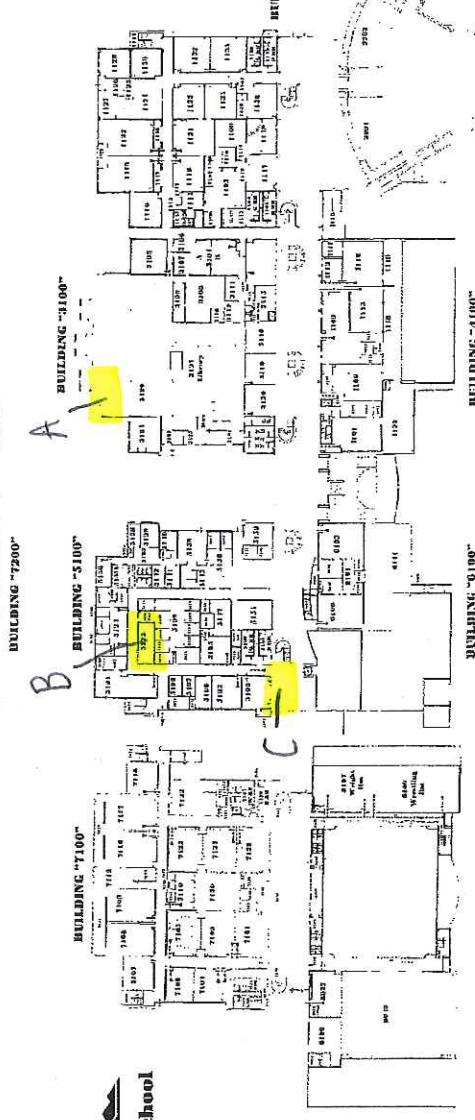


**LOWER LEVEL**



**BUILDING "10,000"**  
Sedgell Field house



**BUILDING "2000"**  
Central Plant



**BUILDING "3000"**  
Circulation



**BUILDING "11,000"**  
Football Field house



**BUILDING "12,000"**  
Baseball Field house

Scottsdale *Unified*  
SCHOOL DISTRICT  
Desert Mountain High School  
New Blueprint Work Up  
TMA Systems July 26, 2009



Water Quality Laboratory

8787 E. Hualapai Dr.  
PO Box 25089  
Scottsdale, AZ 85255

**- CERTIFICATE OF ANALYSIS -**

Lab # AB73161

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

**Date Sampled:** 03/06/2017

**Time Sampled:** 06:02

**Date Received:** 03/06/2017

**Report Date:** 04/12/2017

**Sample ID:** AH17-0447

**Location ID:** Lead in Schools

**Location Description:**

DMHS- Library DF- A

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	04/06/2017

  
Authorized Signature  
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.  
PO Box 25089  
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-0448

Location ID: Lead in Schools

Lab # AB73162

Location Description:

DMHS- Nurse Sink- B

Date Sampled: 03/06/2017

Time Sampled: 06:04

Date Received: 03/06/2017

Report Date: 04/12/2017

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	7.4		1.00	ug/L	1.0	04/06/2017

  
Authorized Signature  
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.  
PO Box 25089  
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-0449

Location ID: Lead in Schools

Lab # AB73163

Date Sampled: 03/06/2017

Time Sampled: 06:06


Date Received: 03/06/2017

Report Date: 04/12/2017

Location Description:

DMHS- Main Hall DF- C

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	04/06/2017

  
Authorized Signature  
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.  
PO Box 25089  
Scottsdale, AZ 85255

**- CERTIFICATE OF ANALYSIS -**

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

**Sample ID:** AH17-0450

**Location ID:** Lead in Schools

**Lab #** AB73164

**Date Sampled:** 03/06/2017

**Time Sampled:** 06:08


**Date Received:** 03/06/2017

**Report Date:** 04/12/2017

**Location Description:**

DMHS- Cafeteria Sink- D

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	1.4		1.00	ug/L	1.0	04/06/2017

  
**Authorized Signature**  
**License #AZ0424**





**Water Quality Laboratory**

8787 E. Hualapai Dr.  
PO Box 25089  
Scottsdale, AZ 85255

**- CERTIFICATE OF ANALYSIS -**

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

**Sample ID:** AH17-0451

**Location ID:** Lead in Schools

**Lab #** AB73165

**Date Sampled:** 03/06/2017

**Time Sampled:** 06:10


**Date Received:** 03/06/2017

**Report Date:** 04/12/2017

**Location Description:**

DMHS- Main Gym DF- E

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	04/06/2017

  
**Authorized Signature**  
**License #**AZ0424



**Water Quality Laboratory**

8787 E. Hualapai Dr.  
PO Box 25089  
Scottsdale, AZ 85255

**- CERTIFICATE OF ANALYSIS -**

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

**Sample ID:** AH17-0452

**Location ID:** Lead in Schools

**Lab #** AB73166

**Date Sampled:** 03/06/2017

**Time Sampled:** 06:12


**Date Received:** 03/06/2017

**Report Date:** 04/12/2017

**Location Description:**

DMHS- Football Field House Sink- F

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	04/06/2017

  
**Authorized Signature**  
**License #AZ0424**



Water Quality Laboratory

8787 E. Hualapai Dr.  
PO Box 25089  
Scottsdale, AZ 85255

**- CERTIFICATE OF ANALYSIS -**

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

**Sample ID:** AH17-0453

**Location ID:** Lead in Schools

**Lab #** AB73167

**Date Sampled:** 03/06/2017

**Time Sampled:** 06:14


**Date Received:** 03/06/2017

**Report Date:** 04/12/2017

**Location Description:**

DMHS- Concession Stand Sink- G

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	35.2		1.00	ug/L	1.0	04/06/2017

  
**Authorized Signature**  
**License #**AZ0424





**Water Quality Laboratory**

8787 E. Hualapai Dr.  
PO Box 25089  
Scottsdale, AZ 85255

**- CERTIFICATE OF ANALYSIS -**

**Lab # AB73168**

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

**Sample ID:** AH17-0454

**Location ID:** Lead in Schools

**Date Sampled:** 03/06/2017

**Time Sampled:** 06:16

**Date Received:** 03/06/2017

**Report Date:** 04/12/2017

**Location Description:**

DMHS- Auditorium DF- H

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	04/06/2017

  
**Authorized Signature**  
License #AZ0424