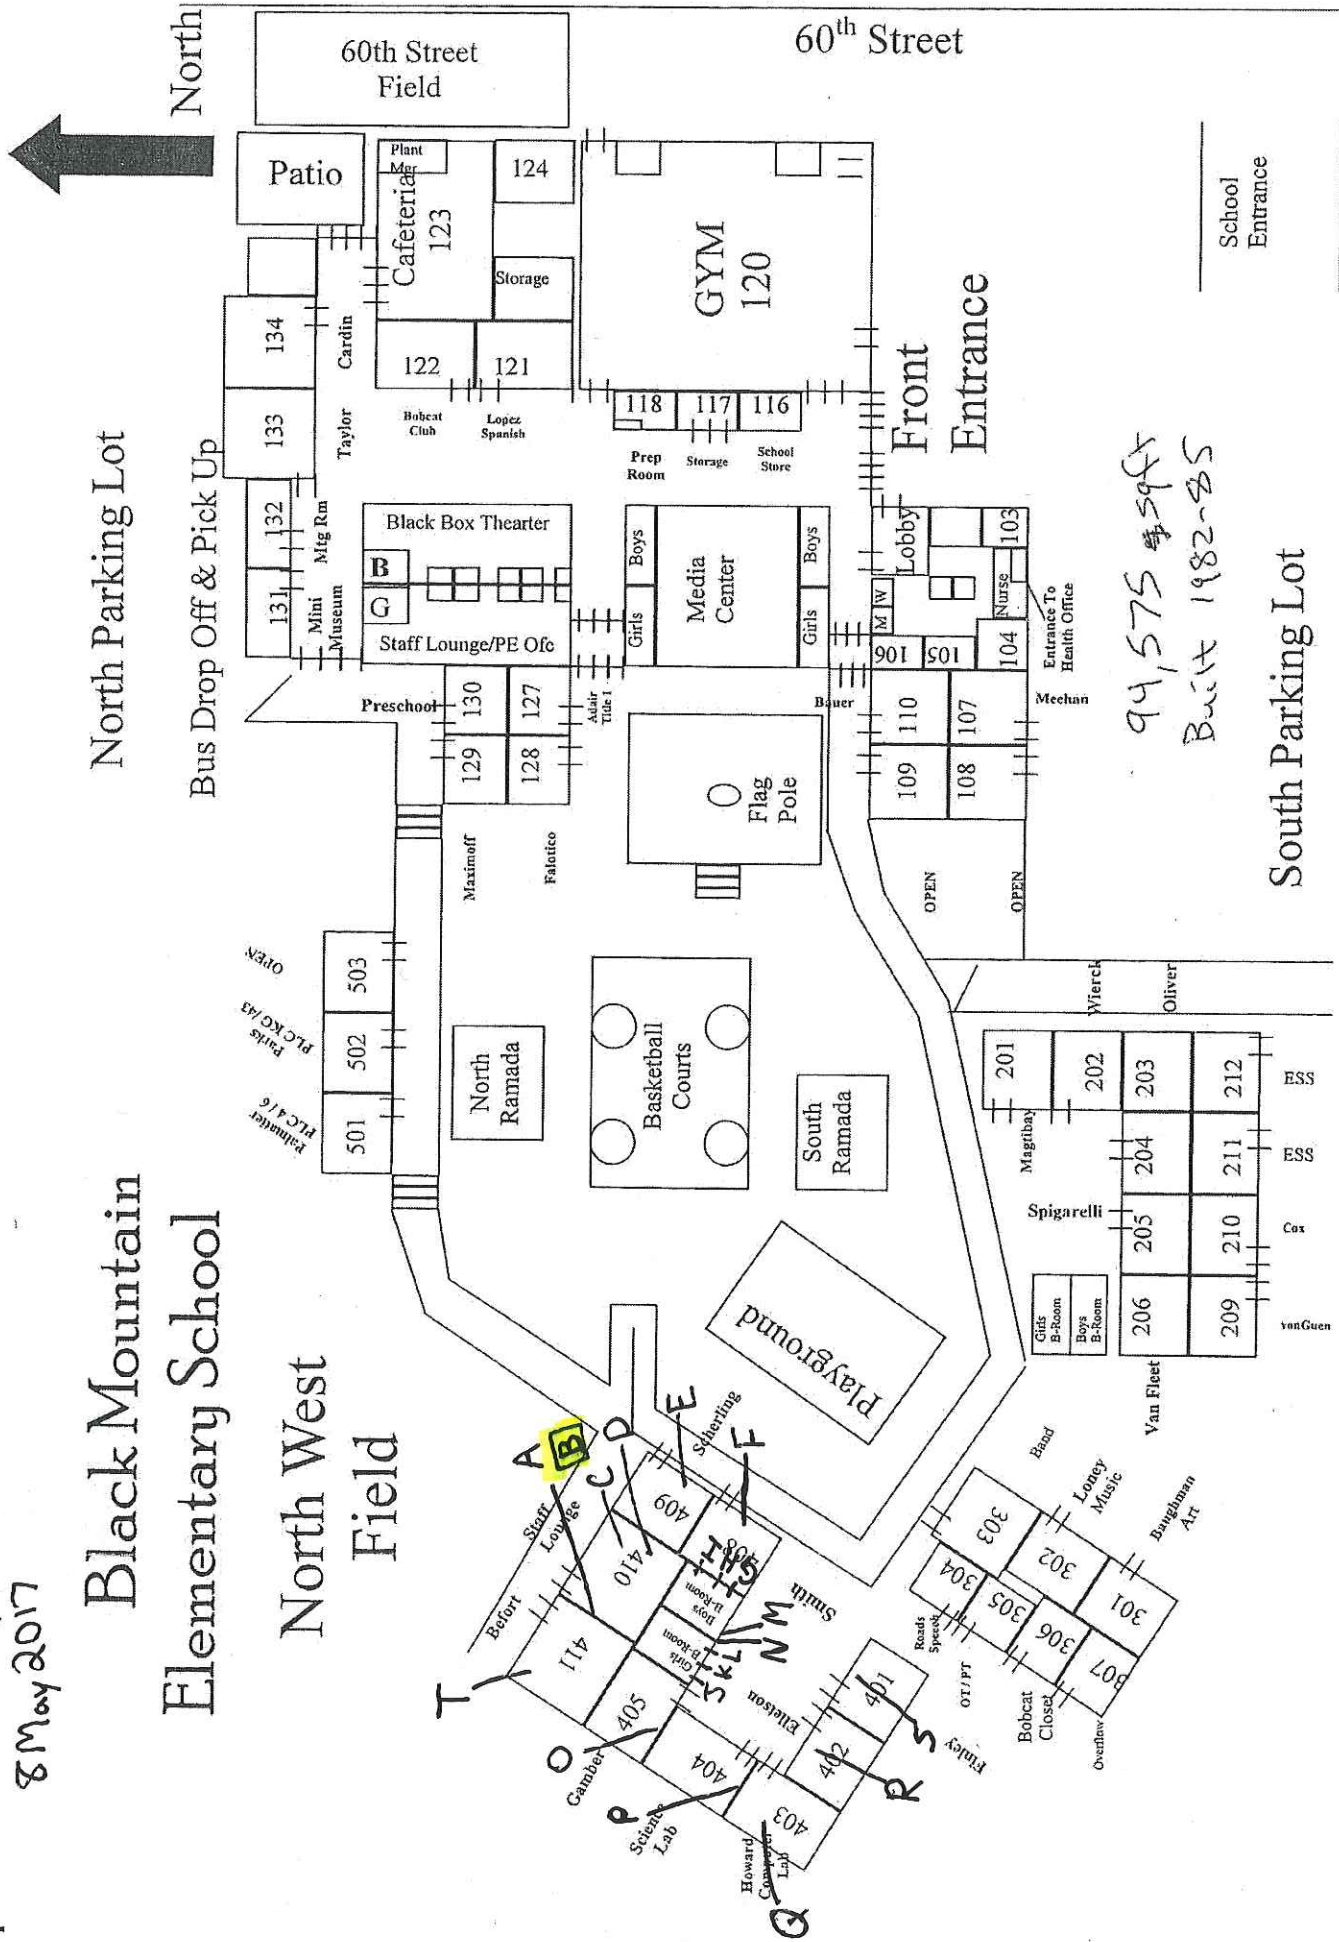


PHASE 2 (DAY 1)

8 May 2017

Black Mountain Elementary School

North West
Field



94,575 sqft
Built 1982-85

□ = 1 min Flush



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1067

Location ID: Lead in Schools

Lab # AB75029

Date Sampled: 05/08/2017

Time Sampled: 05:15


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM410 Sink- A

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	97.1		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1068

Location ID: Lead in Schools

Lab # AB75030

Date Sampled: 05/08/2017

Time Sampled: 05:17

Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM410 Sink Flush- B

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	1.9		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1069

Location ID: Lead in Schools

Lab # AB75031

Date Sampled: 05/08/2017

Time Sampled: 05:19


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM410 Mens RR Sink

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1070

Location ID: Lead in Schools

Lab # AB75032

Date Sampled: 05/08/2017

Time Sampled: 05:21


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM410 Girls RR Sink -I

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1071

Location ID: Lead in Schools

Lab # AB75033

Date Sampled: 05/08/2017

Time Sampled: 05:23


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM409 Sink -E

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	7.7		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1072

Location ID: Lead in Schools

Lab # AB75034

Date Sampled: 05/08/2017

Time Sampled: 05:25


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM408 Sink -F

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	8.8		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1073

Location ID: Lead in Schools

Lab # AB75035

Date Sampled: 05/08/2017

Time Sampled: 05:27


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 Mens RR Sink1 -G

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1074

Location ID: Lead in Schools

Lab # AB75036

Date Sampled: 05/08/2017

Time Sampled: 05:29


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 Mens RR Sink2 -H

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1075

Location ID: Lead in Schools

Lab # AB75037

Date Sampled: 05/08/2017

Time Sampled: 05:31


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 Mens RR Sink3 -I

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1076

Location ID: Lead in Schools

Lab # AB75038

Date Sampled: 05/08/2017

Time Sampled: 05:33

Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 Girls RR Sink1 -J

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017

Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1077

Location ID: Lead in Schools

Lab # AB75039

Date Sampled: 05/08/2017

Time Sampled: 05:35


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 Girls RR Sink2 -K

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1078

Location ID: Lead in Schools

Lab # AB75040

Date Sampled: 05/08/2017

Time Sampled: 05:37


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 Girls RR Sink3 -L

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Lab # AB75041

Krystal Heyer

Date Sampled: 05/08/2017

City of Scottsdale

Time Sampled: 05:39

8787 E. Hualapai Drive

Date Received: 05/08/2017

Scottsdale, AZ 85255

Report Date: 05/19/2017


Sample ID: AH17-1079

Location Description:

Location ID: Lead in Schools

Black Mtn- Bldg 400 RR DF1 -M

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1080

Location ID: Lead in Schools

Lab # AB75042

Date Sampled: 05/08/2017

Time Sampled: 05:41

Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RR DF2 -N

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	< 1.0		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1081

Location ID: Lead in Schools

Lab # AB75043

Date Sampled: 05/08/2017

Time Sampled: 05:43


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM405 Sink- O

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	6.1		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1082

Location ID: Lead in Schools

Lab # AB75044

Date Sampled: 05/08/2017

Time Sampled: 05:45


Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM404 Sink- P

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	9.1		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Lab # AB75045

Date Sampled: 05/08/2017

Krystal Heyer

Time Sampled: 05:47

City of Scottsdale

Date Received: 05/08/2017

8787 E. Hualapai Drive

Report Date: 05/19/2017

Scottsdale, AZ 85255

Sample ID: AH17-1083

Location Description:

Location ID: Lead in Schools

Black Mtn- Bldg 400 RM403 Sink- Q

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	7.3		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1084

Location ID: Lead in Schools

Lab # AB75046

Date Sampled: 05/08/2017

Time Sampled: 05:49

Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM402 Sink- R

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	4.9		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer
City of Scottsdale
8787 E. Hualapai Drive
Scottsdale, AZ 85255

Lab # AB75047


Date Sampled: 05/08/2017
Time Sampled: 05:51
Date Received: 05/08/2017
Report Date: 05/19/2017

Sample ID: AH17-1085
Location ID: Lead in Schools

Location Description:

Black Mtn- Bldg 400 RM401 Sink- S

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	8.7		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424



Water Quality Laboratory

8787 E. Hualapai Dr.
PO Box 25089
Scottsdale, AZ 85255

- CERTIFICATE OF ANALYSIS -

Krystal Heyer

City of Scottsdale

8787 E. Hualapai Drive

Scottsdale, AZ 85255

Sample ID: AH17-1086

Location ID: Lead in Schools

Lab # AB75048

Date Sampled: 05/08/2017

Time Sampled: 05:53

Date Received: 05/08/2017

Report Date: 05/19/2017

Location Description:

Black Mtn- Bldg 400 RM411 Sink- T

Test	Method	Result	Data Qualifier	DF	Units	PQL	Analysis Date
Lead, Pb	EPA 200.8	11.5		1.00	ug/L	1.0	05/17/2017


Authorized Signature
License #AZ0424