

David A. Burchard
Arizona Department of Environmental Quality, PHX
1110 W. Washington Street
Phoenix, AZ 85007

Project: School Lead Testing Screening
Project Number: Maryland

Reported:
05/05/17 14:35

Analyte

J1010-01 (7042656-01) Drinking Water (Grab) Sampled: 04/25/17 05:10 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:05	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

A1001-02 (7042656-02) Drinking Water (Grab) Sampled: 04/25/17 05:16 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:09	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

A1001-03 (7042656-03) Drinking Water (Grab) Sampled: 04/25/17 05:19 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:20	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

B1002-04 (7042656-04) Drinking Water (Grab) Sampled: 04/26/17 05:08 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:24	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

B1002-05 (7042656-05) Drinking Water (Grab) Sampled: 04/26/17 05:15 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:28	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

L1012-06 (7042656-06) Drinking Water (Grab) Sampled: 04/25/17 05:30 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:39	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

C1003-07 (7042656-07) Drinking Water (Grab) Sampled: 04/26/17 05:20 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
---------	--------	-----	-------	----------	-------	----------	----------	--------	-------

Legend Technical Services of Arizona, Inc.



Client Services Representative

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Phone Number: (602) 324-6100

Page 1 of 24

David A. Burchard
Arizona Department of Environmental Quality, PHX
1110 W. Washington Street
Phoenix, AZ85007

Project: School Lead Testing Screening
Project Number: Maryland

Reported:
05/05/17 14:35

C1003-07 (7042656-07) Drinking Water (Grab) Sampled: 04/26/17 05:20 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:43	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

C1003-08 (7042656-08) Drinking Water (Grab) Sampled: 04/26/17 05:23 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:47	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

M1013-09 (7042656-09) Drinking Water (Grab) Sampled: 04/25/17 05:42 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:51	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

D1004-10 (7042656-10) Drinking Water (Grab) Sampled: 04/25/17 05:45 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:55	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

I1009-12 (7042656-11) Drinking Water (Grab) Sampled: 04/25/17 05:52 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	11	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 20:58	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

D1004-11 (7042656-12) Drinking Water (Grab) Sampled: 04/25/17 05:48 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0957	05/01/17 16:55	05/01/17 21:02	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

H1008-14 (7042656-13) Drinking Water (Grab) Sampled: 04/26/17 05:26 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0958	05/01/17 16:57	05/01/17 21:33	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

H1008-15 (7042656-14) Drinking Water (Grab) Sampled: 04/26/17 05:30 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

H1008-15 (7042656-14) Drinking Water (Grab) Sampled: 04/26/17 05:30 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0958	05/01/17 16:57	05/01/17 21:36	EPA 200.8	
------	------	-----	------	---	---------	----------------	----------------	-----------	--

G1007-16 (7042656-15) Drinking Water (Grab) Sampled: 04/26/17 05:34 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0958	05/01/17 16:57	05/01/17 21:40	EPA 200.8	
------	------	-----	------	---	---------	----------------	----------------	-----------	--

G1007-17 (7042656-16) Drinking Water (Grab) Sampled: 04/26/17 05:37 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0958	05/01/17 16:57	05/01/17 21:44	EPA 200.8	
------	------	-----	------	---	---------	----------------	----------------	-----------	--

F1006-18 (7042656-17) Drinking Water (Grab) Sampled: 04/26/17 05:40 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0958	05/01/17 16:57	05/01/17 21:48	EPA 200.8	
------	------	-----	------	---	---------	----------------	----------------	-----------	--

F1006-19 (7042656-18) Drinking Water (Grab) Sampled: 04/26/17 05:45 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0958	05/01/17 16:57	05/01/17 21:52	EPA 200.8	
------	------	-----	------	---	---------	----------------	----------------	-----------	--

E1005-20 (7042656-19) Drinking Water (Grab) Sampled: 04/26/17 05:50 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0958	05/01/17 16:57	05/01/17 21:55	EPA 200.8	
------	------	-----	------	---	---------	----------------	----------------	-----------	--

E1005-21 (7042656-20) Drinking Water (Grab) Sampled: 04/26/17 05:52 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0958	05/01/17 16:57	05/01/17 21:59	EPA 200.8	
------	------	-----	------	---	---------	----------------	----------------	-----------	--

I1009-13 (7042656-21) Drinking Water (Grab) Sampled: 04/25/17 05:56 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

David A. Burchard
Arizona Department of Environmental Quality, PHX
1110 W. Washington Street
Phoenix, AZ85007

Project: School Lead Testing Screening
Project Number: Maryland

Reported:
05/05/17 14:35

1009-13 (7042656-21) Drinking Water (Grab) Sampled: 04/25/17 05:56 Received: 04/27/17 11:15

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

Total Metals

Lead	<5.0	5.0	ug/L	1	B7E0958	05/01/17 16:57	05/01/17 22:11	EPA 200.8	
------	------	-----	------	---	---------	----------------	----------------	-----------	--

Sample Condition Upon Receipt:

Temperature: 18.00 °C

All samples were received in acceptable condition unless noted otherwise in the case narrative.

Case Narrative:

Holding Times: All holding times were met unless otherwise qualified.

QA/QC Criteria: All analyses met method requirements unless otherwise qualified.

Accreditations: AZ(PHX)0004, AZ(TUC)0004, AIHA#102982, CDC ELITE Member.

Accreditation is applicable only to the test methods specified on each scope of accreditation held by LEGEND.

Comments: There were no problems encountered during the processing of the samples, unless otherwise noted.
All samples were analyzed on a "wet" basis unless designated as "dry weight".

Lead samples are preserved with Nitric acid upon receipt at the laboratory. However, some samples were analyzed prior to the 16 hour preservation waiting period due to urgency of analysis, per the client's request. Results are not for compliance purpose.

Notes and Definitions

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

7042656-01

Collection Log
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	J1010
Type of Fixture (tap, drinking fountain etc.)	KITCHEN SINK
Location of Fixture (example, room number)	KITCHEN CENTER
Sample Identification Number (Write this number on the sample container and on this sheet)	J1010-01
Date of Collection	4-25-17
Time of Collection	0510
Printed Name of Sample Collector	ALEX HENRIQUEZ
Signature Sample Collector	<i>Alex Henriquez</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	REC'D @ Lab 4/27/17 1020 Preserved @ Lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-02

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	A1001
Type of Fixture (tap, drinking fountain etc.)	SINK
Location of Fixture (example, room number)	NURSE'S OFFICE
Sample Identification Number (Write this number on the sample container and on this sheet)	A1001-02
Date of Collection	4-25-17
Time of Collection	0916
Printed Name of Sample Collector	ALEX HENRIQUEZ
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____
These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-03

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	A1001
Type of Fixture (tap, drinking fountain etc.)	SINK
Location of Fixture (example, room number)	LIBRARY WORK ROOM A116
Sample Identification Number (Write this number on the sample container and on this sheet)	A1001-03
Date of Collection	4-25-17
Time of Collection	0519
Printed Name of Sample Collector	ALEX HENRIQUEZ
Signature Sample Collector	<i>Alex Henriquez</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	
18.0°C	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log


Collection Log

for experienced sample collectors

7042456-04

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	31002
Type of Fixture (tap, drinking fountain etc.)	Drinking fountain
Location of Fixture (example, room number)	Rm 25
Sample Identification Number (Write this number on the sample container and on this sheet)	31002-04
Date of Collection	4-26-17
Time of Collection	0608
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-05

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	B1002
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Rm 23
Sample Identification Number (Write this number on the sample container and on this sheet)	151002-05
Date of Collection	4-26-17
Time of Collection	0515
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____
These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-06

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	L1012
Type of Fixture (tap, drinking fountain etc.)	SINK
Location of Fixture (example, room number)	RM. 21A
Sample Identification Number (Write this number on the sample container and on this sheet)	L1012-06
Date of Collection	4-25-17
Time of Collection	0930
Printed Name of Sample Collector	ALEX HENRIQUEZ
Signature Sample Collector	<i>Alex Henriquez</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Recvd @ 10.5 4/27/17 1020 Preserved @ 10.6 4/27/17 1115

18.0°C

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-07

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Rm 14
Sample Identification Number (Write this number on the sample container and on this sheet)	C1003-07
Date of Collection	4-26-17
Time of Collection	0520
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	<i>[Signature]</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Recvd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

7042656-08

Collection Log
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	C1093
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Room 12
Sample Identification Number (Write this number on the sample container and on this sheet)	C1003-08
Date of Collection	4-26-17
Time of Collection	05:23
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____
These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-09

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	M1013
Type of Fixture (tap, drinking fountain etc.)	SINK
Location of Fixture (example, room number)	RM. 11A
Sample Identification Number (Write this number on the sample container and on this sheet)	M1013-09
Date of Collection	4-25-17
Time of Collection	0542
Printed Name of Sample Collector	ALEX HENRIQUEZ
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1620 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____
These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-10

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	D1004
Type of Fixture (tap, drinking fountain etc.)	DRINKING FOUNTAIN
Location of Fixture (example, room number)	RM. 5
Sample Identification Number (Write this number on the sample container and on this sheet)	D1004-10
Date of Collection	4-25-17
Time of Collection	0545
Printed Name of Sample Collector	ALEX HENRIQUEZ
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-11

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	I 1009
Type of Fixture (tap, drinking fountain etc.)	SINK
Location of Fixture (example, room number)	RM. 6
Sample Identification Number (Write this number on the sample container and on this sheet)	I 1009-12
Date of Collection	4-25-17
Time of Collection	0552
Printed Name of Sample Collector	ALEX HENRIQUEZ
Signature Sample Collector	<i>Alex Henriquez</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Recvd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____
These samples were collected for lead screening purposes only and cannot be used for compliance.

ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District WASHINGTON ELEMENTARY DISTRICT
School Name MARYLAND
Building (name/number) I 1009
Type of Fixture (tap, drinking fountain etc.) DRINKING FOUNTAIN
Location of Fixture (example, room number) RM. 9
Sample Identification Number (**Write this number on the sample container and on this sheet**) I 1009-13
Date of Collection 4-25-17
Time of Collection 0556
Printed Name of Sample Collector ALEX HENRIQUEZ
Signature Sample Collector [Signature]

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	
<u>18.0°C</u>	<u>Recvd @ lab 4/27/17 1020</u> <u>Preserved @ lab 4/27/17 1115</u>

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-13

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	H1008
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Exterior Boys RR - South Hall
Sample Identification Number (Write this number on the sample container and on this sheet)	H 1008 - 14
Date of Collection	4-26-17
Time of Collection	0536
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	REC'D @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____
These samples were collected for lead screening purposes only and cannot be used for compliance.


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-14

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	H-1008
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Room 28 - Interior East Wall
Sample Identification Number (Write this number on the sample container and on this sheet)	H1008-15
Date of Collection	4-26-17
Time of Collection	0530
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	REC'D @ lab 4/27/17 1020 PRESERVED @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-15

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that water had not been used at this tap or other taps in the area for 6 hours and no flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	G 1007
Type of Fixture (tap, drinking fountain etc.)	Sink
Location of Fixture (example, room number)	Room 30 - Interior South wall
Sample Identification Number (Write this number on the sample container and on this sheet)	G 1007 - 16
Date of Collection	4-26-17
Time of Collection	0534
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	REC'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____
These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-16

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	G1007-17
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Rm. 27 - Exterior South Wall
Sample Identification Number (Write this number on the sample container and on this sheet)	G1007-17
Date of Collection	4-26-17
Time of Collection	0537
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	REC'd @ lab 4/27/17 1020 PRESERVED @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only
Relinquished date and signature _____
These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-17

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that water had not been used at this tap or other taps in the area for 6 hours and no flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	F1006
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Room 39 - Exterior South Wall
Sample Identification Number (Write this number on the sample container and on this sheet)	F1006-18
Date of Collection	4-26-17
Time of Collection	0540
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-18

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	F1006
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Staff Lounge - Interior West wall
Sample Identification Number (Write this number on the sample container and on this sheet)	F1006-19
Date of Collection	4-26-17
Time of Collection	0545
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

18.0°C

For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program
Sampling Plan & Collection Log

Collection Log
for experienced sample collectors

7042656-20

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	MARYLAND
Building (name/number)	E1005
Type of Fixture (tap, drinking fountain etc.)	Drinking Fountain
Location of Fixture (example, room number)	Room 4B - Interior West Wall
Sample Identification Number (Write this number on the sample container and on this sheet)	E1005-21
Date of Collection	4-26-17
Time of Collection	0552
Printed Name of Sample Collector	ANDRE ROBLES
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @lab 4/27/17 1620 Preserved @lab 4/27/17 1115

18.0°C

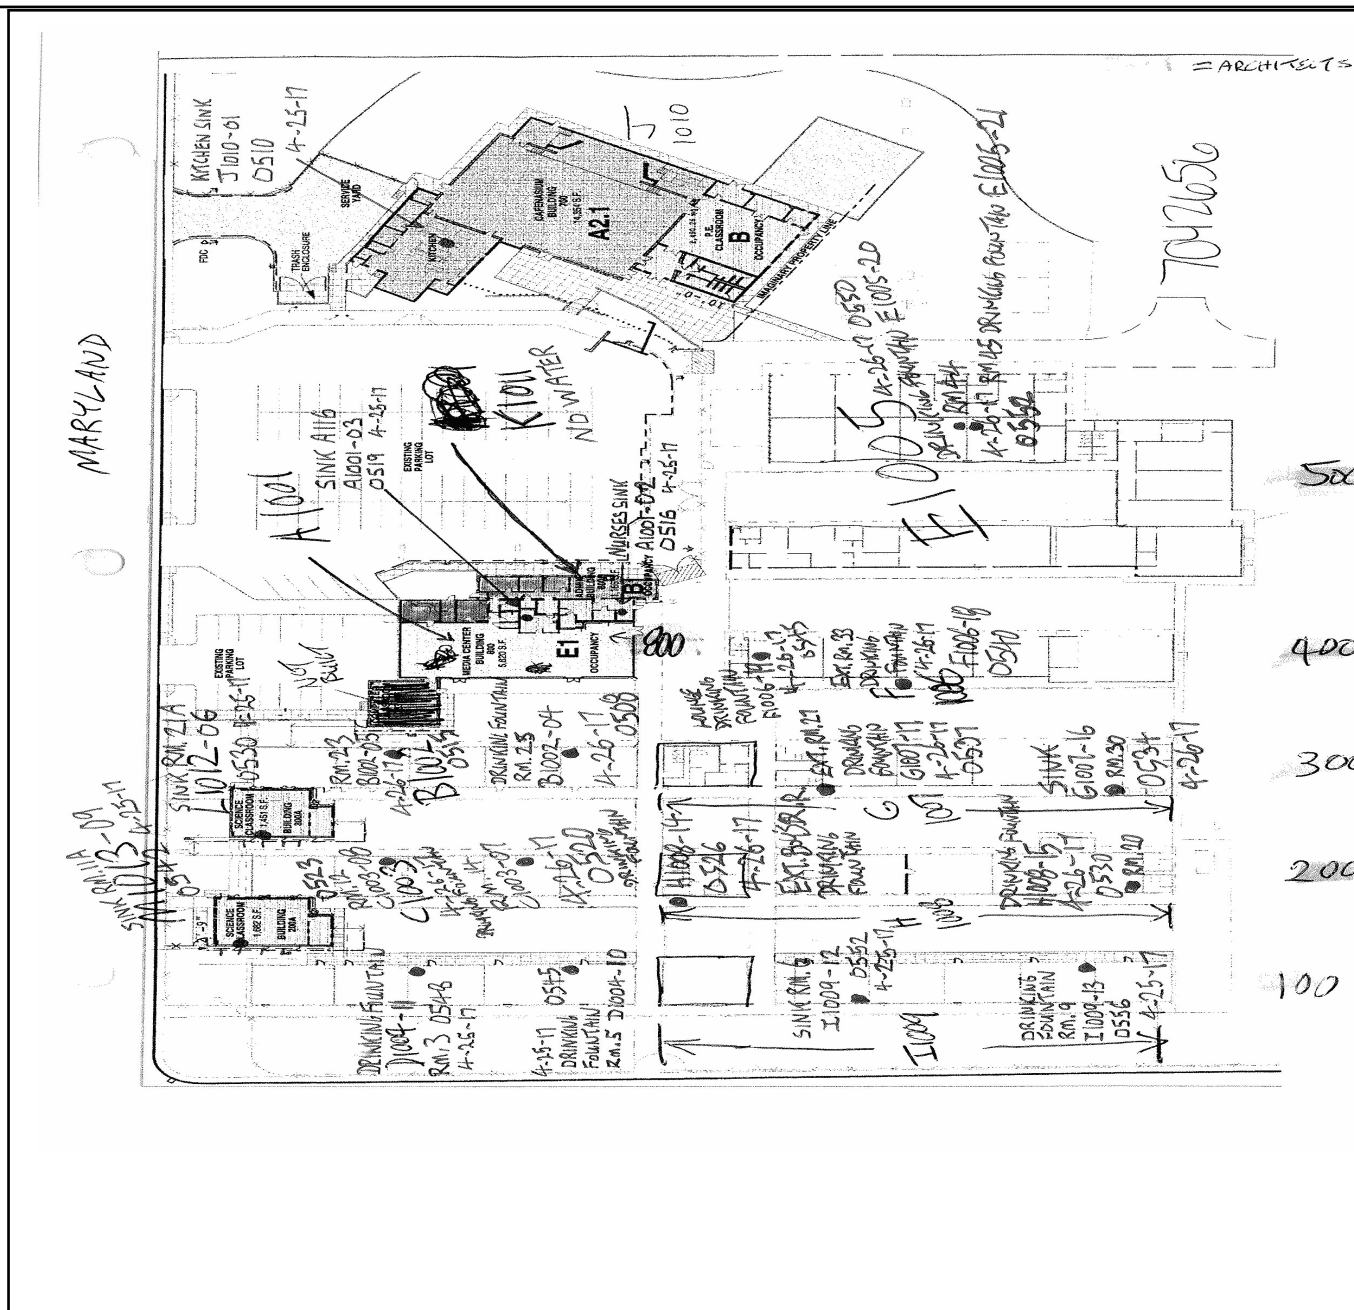
For relinquishing samples upon delivery to labs only

Relinquished date and signature _____

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2



The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.