

David A. Burchard  
Arizona Department of Environmental Quality, PHX  
1110 W. Washington Street  
Phoenix, AZ85007

Project: School Lead Testing Confirmation (RUSH)  
Project Number: Sunset

Reported:  
05/03/17 08:46

## Analyte

**1 Confirmation- First Draw (7042655-01) Drinking Water (Grab) Sampled: 04/21/17 05:20 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

## Total Metals

Lead	32	5.0	ug/L	1	B7D1815	04/28/17 10:24	04/28/17 13:23	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

**2 Confirmation- Flush (7042655-02) Drinking Water (Grab) Sampled: 04/21/17 05:23 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

## Total Metals

Lead	<5.0	5.0	ug/L	1	B7D1815	04/28/17 10:24	04/28/17 13:27	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

**3 Confirmation- First Draw Day Two (7042655-03) Drinking Water (Grab) Sampled: 04/22/17 06:20 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

## Total Metals

Lead	20	5.0	ug/L	1	B7D1815	04/28/17 10:24	04/28/17 13:31	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

**4 Screening (7042655-04) Drinking Water (Grab) Sampled: 04/21/17 05:30 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

## Total Metals

Lead	<5.0	5.0	ug/L	1	B7D1815	04/28/17 10:24	04/28/17 13:35	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

**5 Screening (7042655-05) Drinking Water (Grab) Sampled: 04/21/17 05:35 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

## Total Metals

Lead	<5.0	5.0	ug/L	1	B7D1815	04/28/17 10:24	04/28/17 13:38	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

**6 Screening (7042655-06) Drinking Water (Grab) Sampled: 04/21/17 05:40 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

## Total Metals

Lead	<5.0	5.0	ug/L	1	B7D1815	04/28/17 10:24	04/28/17 13:42	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

**7 Screening (7042655-07) Drinking Water (Grab) Sampled: 04/21/17 05:48 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
---------	--------	-----	-------	----------	-------	----------	----------	--------	-------

Legend Technical Services of Arizona, Inc.



Client Services Representative

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Phone Number: (602) 324-6100

Page 1 of 18

David A. Burchard  
Arizona Department of Environmental Quality, PHX  
1110 W. Washington Street  
Phoenix, AZ85007

Project: School Lead Testing Confirmation (RUSH)  
Project Number: Sunset

Reported:  
05/03/17 08:46

**7 Screening (7042655-07) Drinking Water (Grab) Sampled: 04/21/17 05:48 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

**Total Metals**

Lead	10	5.0	ug/L	1	B7D1815	04/28/17 10:24	04/28/17 13:46	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

**8 Screening (7042655-08) Drinking Water (Grab) Sampled: 04/21/17 05:51 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

**Total Metals**

Lead	<5.0	5.0	ug/L	1	B7D1815	04/28/17 10:24	04/28/17 13:57	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

**9 Screening (7042655-09) Drinking Water (Grab) Sampled: 04/21/17 05:56 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

**Total Metals**

Lead	33	5.0	ug/L	1	B7D1815	04/28/17 10:24	04/28/17 14:01	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

**10 Screening (7042655-10) Drinking Water (Grab) Sampled: 04/21/17 05:59 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

**Total Metals**

Lead	10	5.0	ug/L	1	B7D1825	04/28/17 13:18	04/28/17 14:26	EPA 200.8
------	----	-----	------	---	---------	----------------	----------------	-----------

**11 Screening (7042655-11) Drinking Water (Grab) Sampled: 04/21/17 05:43 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

**Total Metals**

Lead	<5.0	5.0	ug/L	1	B7D1825	04/28/17 13:18	04/28/17 14:30	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

**12 Screening (7042655-12) Drinking Water (Grab) Sampled: 04/21/17 06:05 Received: 04/27/17 10:20**

Analyte	Result	PQL	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Legend Technical Services of Arizona, Inc.									

**Total Metals**

Lead	<5.0	5.0	ug/L	1	B7D1825	04/28/17 13:18	04/28/17 14:34	EPA 200.8
------	------	-----	------	---	---------	----------------	----------------	-----------

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

**Sample Condition Upon Receipt:**

Temperature: 18.00 °C

All samples were received in acceptable condition unless noted otherwise in the case narrative.

**Case Narrative:**

**Holding Times:** All holding times were met unless otherwise qualified.

**QA/QC Criteria:** All analyses met method requirements unless otherwise qualified.

**Accreditations:** **AZ(PHX)0004, AZ(TUC)0004, AIHA#102982, CDC ELITE Member.**

Accreditation is applicable only to the test methods specified on each scope of accreditation held by LEGEND.

**Comments:** There were no problems encountered during the processing of the samples, unless otherwise noted.  
All samples were analyzed on a "wet" basis unless designated as "dry weight".

*Lead samples are preserved with Nitric acid upon receipt at the laboratory. However, some samples were analyzed prior to the 16 hour preservation waiting period due to urgency of analysis, per the client's request. Results are not for compliance purpose.*

---


**Notes and Definitions**

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK
Location of Fixture (example, room number)	RM. 514 NORTH WALL
Sample Identification Number ( <b>Write this number on the sample container and on this sheet</b> )	1 CONFIRMATION - FIRST DRAW
Date of Collection	4-21-17
Time of Collection	5:20AM
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	
19.0°C	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only

Relinquished date and signature \_\_\_\_\_

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


7042655

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK
Location of Fixture (example, room number)	RM. 514 NORTH WALL
Sample Identification Number ( <b>Write this number on the sample container and on this sheet</b> )	2 CONFIRMATION - FLUSH
Date of Collection	4-21-17
Time of Collection	5:23 A.M.
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only  
Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

7042655

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK WITH DRINKING FOUNTAIN
Location of Fixture (example, room number)	Rm. 507 WEST WALL
Sample Identification Number ( <b>Write this number on the sample container and on this sheet</b> )	4 SCREENING
Date of Collection	4-21-17
Time of Collection	5:30 AM
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	MIKE KRAMER

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

18.0°C

For relinquishing samples upon delivery to labs only

Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>


Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK WITH DRINKING FOUNTAIN
Location of Fixture (example, room number)	RM. 508 EAST WALL
Sample Identification Number (Write this number on the sample container and on this sheet)	5 SCREENING
Date of Collection	4-21-17
Time of Collection	5:35 AM
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only  
Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK WITH DRINKING FOUNTAIN
Location of Fixture (example, room number)	RM. 506 EAST WALL
Sample Identification Number ( <b>Write this number on the sample container and on this sheet</b> )	6 SCREENING
Date of Collection	4-21-17
Time of Collection	5:40 A.M.
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	MIKE KRAMER

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only  
Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2



ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK WITH DRINKING FOUNTAIN
Location of Fixture (example, room number)	RM. 503 WEST WALL
Sample Identification Number (Write this number on the sample container and on this sheet)	7 SCREENING
Date of Collection	4-26-17
Time of Collection	5:48 AM
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	MIKE KRAMER

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only  
Relinquished date and signature \_\_\_\_\_

These samples were collected for lead screening purposes only and cannot be used for compliance.

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

**Collection Log**  
*for experienced sample collectors*

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK WITH DRINKING FOUNTAIN
Location of Fixture (example, room number)	RM. 504 EAST WING
Sample Identification Number (Write this number on the sample container and on this sheet)	8 SCREENING
Date of Collection	4-21-17
Time of Collection	5:51 AM
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	MIKE KRAMER

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes: 18.0°C Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115	

For relinquishing samples upon delivery to labs only

Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

7042655

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK WITH DRINKING FOUNTAIN
Location of Fixture (example, room number)	RM 501 WEST WALL
Sample Identification Number ( <b>Write this number on the sample container and on this sheet</b> )	9 SCREENING
Date of Collection	4-21-17
Time of Collection	5:56 AM
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	MIKE KRAMER

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Recvd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only  
Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

7042655

**Collection Log**  
*for experienced sample collectors*

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK WITH DRINKING FOUNTAIN
Location of Fixture (example, room number)	Rm. 502 EAST WALL
Sample Identification Number ( <b>Write this number on the sample container and on this sheet</b> )	10 SCREENING
Date of Collection	4-21-17
Time of Collection	5:54 A.M.
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	<i>MIKE KRAMER</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only  
Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

7042655

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK WITH DRINKING FOUNTAIN
Location of Fixture (example, room number)	RM. 505 WEST WALK
Sample Identification Number ( <b>Write this number on the sample container and on this sheet</b> )	11 SCREENING
Date of Collection	4-21-17
Time of Collection	5:43 AM
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	MIKE KRAMER

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only  
Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

7042655

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	DRINKING FOUNTAIN
Location of Fixture (example, room number)	EXTERIOR OF RM. 515
Sample Identification Number (Write this number on the sample container and on this sheet)	12 SCREENING
Date of Collection	4-21-17
Time of Collection	6:05 AM
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	<i>MIKE KRAMER</i>

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Rec'd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only

Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2


ADEQ Public School Drinking Water Lead Screening Program  
Sampling Plan & Collection Log

2042655

**Collection Log**  
for experienced sample collectors

Complete copy of this form for each sample collected. Your drinking water sample cannot be tested unless a copy of this form is shipped to the lab with each sample. In addition, the sample cannot be tested unless the Sample Identification Number matches the number on the sample container label.

☒ Check this box to confirm that **water had not been used at this tap or other taps in the area for 6 hours** and **no** flushing was done prior to sampling

Name of School District	WASHINGTON ELEMENTARY DISTRICT
School Name	SUNSET
Building (name/number)	C1003
Type of Fixture (tap, drinking fountain etc.)	SINK
Location of Fixture (example, room number)	RM. 514 NORTH WALL
Sample Identification Number ( <b>Write this number on the sample container and on this sheet</b> )	3 CONFIRMATION - FIRST DRAW DAY TWO
Date of Collection	4-22-17
Time of Collection	6:20AM
Printed Name of Sample Collector	MIKE KRAMER
Signature Sample Collector	

Notes Sample collector:

For Lab use only	
Analyze this drinking water sample for lead	
Date and Time Lab received	
Signature	
Notes:	Recvd @ lab 4/27/17 1020 Preserved @ lab 4/27/17 1115

For relinquishing samples upon delivery to labs only

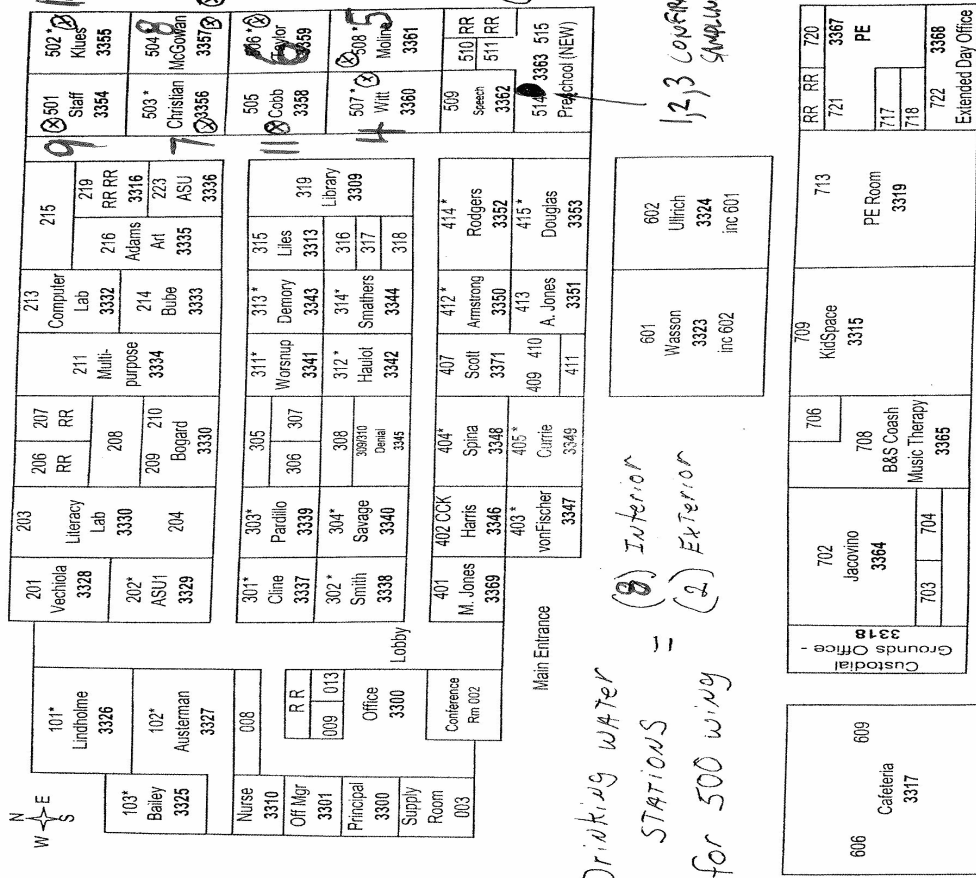
Relinquished date and signature \_\_\_\_\_

*These samples were collected for lead screening purposes only and cannot be used for compliance.*

<http://www.azdeq.gov/LeadScreeningProg>

Page 2 of 2

Sunset School  
 2016-2017



Drinking water  
 STATIONS =  
 for 500 wing

1,2,3 CONFIRMATION  
 SAMPLING

SUNSET 4-21-17 AND 4-22-17

As of 6/6/2016

\* = Smart Board in room.



7042055

Lead In Schools Confirmation Sampling Log					
School District: Washington Elementary District					
School Name: Sunset School					
Building Name/Number/Year Built: Building C10003/North wall Sink Room 514/1977					
Sample Collector Name and Phone Number:					
Sample ID # (must appear on bottle)	Bottle Size	Fixture Type/ Make and model #	Fixture location	Collection Time	Collection Date
1 Confirmation - First Draw	250 ml	SINK, DETATECK 8673 53	NORTH WALL RM. 514	5:20 AM	4-21-17
2 Confirmation - Flush	250 ml	SINK " " "	NORTH WALL RM. 514	5:23 AM	4-21-17
3 Confirmation - First Draw Day Two	1 Liter	SINK " " "	NORTH WALL RM. 514	6:20 AM	4-22-17
4 Screening	250 ml	S/D, CHICAGO 748-665 ABCP	WEST WALL RM. 507	5:30 AM	4-21-17
5 Screening	250 ml	SIDE " " "	EAST WALL RM. 508	5:35 AM	4-21-17
6 Screening	250 ml	SIDE " " "	EAST WALL RM. 506	5:40 AM	4-21-17
7 Screening	250 ml	SIDE, CENTRAL BRASS 0304-L	WEST WALL RM. 503	5:48 AM	4-21-17
8 Screening	250 ml	SIDE, HAWES 5010, 6127, SS	EAST WALL RM. 504	5:51 AM	4-21-17
9 Screening	250 ml	SIDE " " "	WEST WALL RM. 501	5:56 AM	4-21-17
10 Screening	250 ml	SIDE " " "	EAST WALL RM. 502	5:59 AM	4-21-17
11 SCREENING	250 ml	S/D, CHICAGO 748-665 ABCP	WEST WALL RM. 505	5:43 AM	4-21-17
12 SCREENING	250 ml	DE, ELKAY EDF310C	EXTERIOR OF RM. 515	6:05 AM	4-21-17
<div style="text-align: center;"> <h1>RUSH</h1> <p>5/11/17            mw            4/19/17</p> <p>DF = DRINKING FOUNTAIN (THREE BUBBLERS)            S/DF = SINK WITH DRINKING FOUNTAIN (ONE BUBBLER)</p> </div>					

These samples were collected for screening purposes only and are not to be used for compliance determinations

For relinquishing samples upon delivery to labs only

DATE RELINQUISHED:	
RELINQUISHING AGENT SIGNATURE:	
SIGNATORY NAME PRINTED:	

For Lab Use Only

ANALYZE THIS DRINKING WATER SAMPLE FOR LEAD

DATE LAB RECEIVED:	4/27/17
TIME LAB RECEIVED:	1020
LAB SIGNATURE:	<i>[Signature]</i>
LAB SIGNATORY NAME PRINTED:	Michael
NOTES:	Picked up by Euan Northrup

RUSH